


TYPICAL CITY BLOCK PLAN

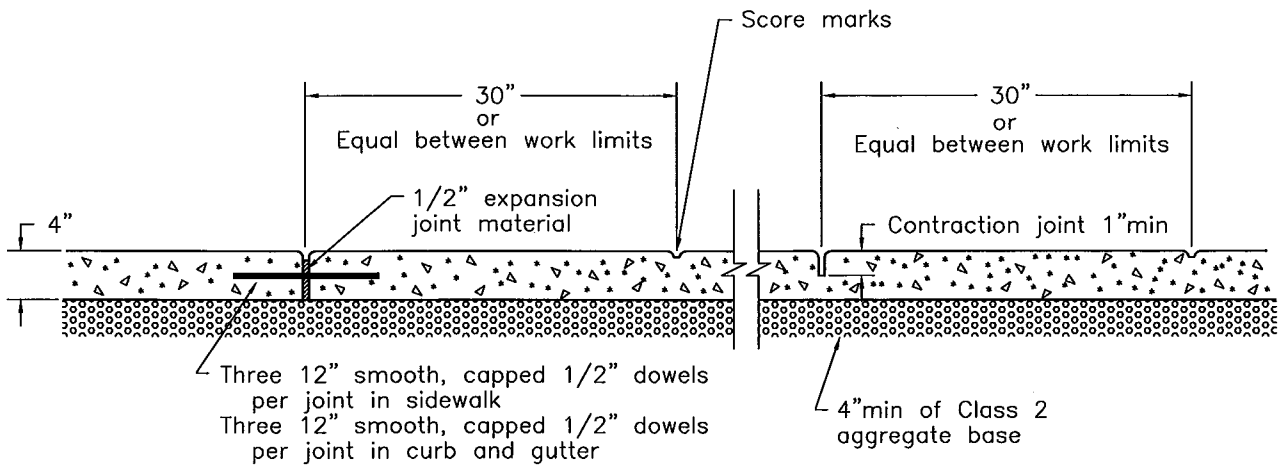

Expansion joint

Contraction joint

LONGITUDINAL SECTIONS

NOTES

1. Sidewalks to be marked in 30" squares.
2. Edges to have a 3/4" radius.
3. Score marks shall not be less than 3/8" deep; contraction joints shall be 1" minimum depth.
4. Contraction joints may be saw cut.
5. Sidewalks to have 2% slope to street.
6. All new sidewalk shall be doweled at 2' O.C. into existing concrete with #4, 12" long dowels and embedded 6".
7. Sawcut walk full depth and full width on score marks perpendicular to the curb. No sawcutting on longitudinal score marks.
8. Install longitudinal deep score along entire back of curb that is monolithic with the sidewalk.

Rev	By	Date
0	DWH	12/14/92
1	MN	01/29/02
2	HQN	01/04/07

Sidewalk Construction

City of Palo Alto Standard

Approved by:	
PE No.	35411
Date	5/14/07
Dwg No.	141

Scale: NTS