


TOP VIEW

NO OBSTRUCTIONS ALLOWED IN SHADED AREA.

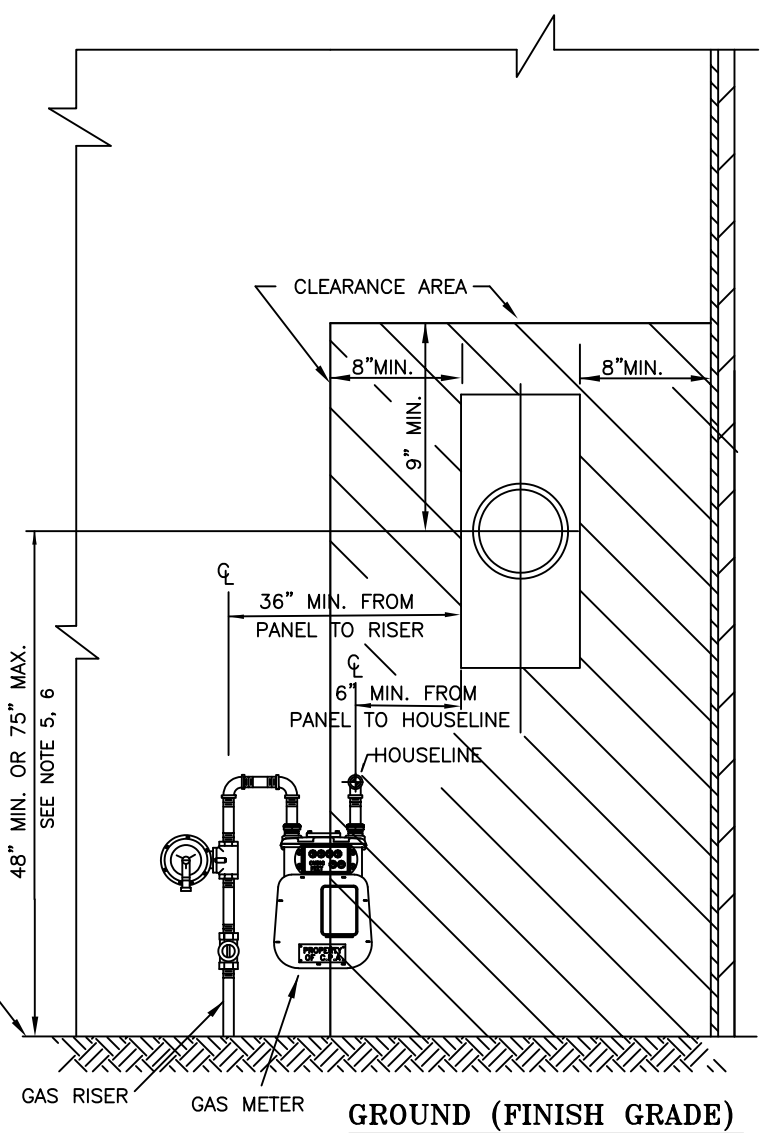

GROUND (FINISH GRADE)

NOTES:

1. THERE MUST BE AN 8 INCH MINIMUM CLEARANCE BETWEEN THE NEAREST EDGE OF THE METER PANEL AND ANY OBSTRUCTION OR WINDOW.
2. SUITABLE WORKING SPACE, AT LEAST 30 INCHES WIDE X 36 INCHES DEEP, SHALL BE PROVIDED IN FRONT OF THE METER SOCKET TO ALLOW FOR INSTALLATION, TESTING AND READING.
3. METERS SHALL BE LOCATED SO THAT THEY WILL NOT BE DAMAGED BY A SWINGING WINDOW OR DOOR.
4. THE WALL SURFACES ON EITHER SIDE OF A DOOR, FOR A DISTANCE EQUAL TO THE WIDTH OF THE DOOR, IS UNACCEPTABLE AS A METER LOCATION.
5. PER CEC ARTICLE 404.8(A) THE HIGHEST POSITION OF THE BREAKER HANDLE MUST BE LESS THAN 79" ABOVE GRADE/FLOOR.
6. SEE CPAU ENG STD SR-MT-E-1035 FOR REQUIREMENTS ON METERS INSTALLED IN DRIVEWAYS.

7	3-16	REVISED NOTES	TT
6	6-14	ADDED GUARD POST NOTE	TT
5	7-13	REVISED GAS METER	TT
4	1-11	REVISED CLEARANCES AND NOTES	TT
3	8-08	REVISED CLEARANCES AND NOTES	JT
2	6-06	REVISED CLEARANCES	TF
REV	DATE	DESCRIPTION	APPR

APPROVED 3/1994

MOB
ENGR. MANAGER

ENGINEERING STANDARD

REQUIRED MINIMUM CLEARANCES OF METER SOCKET FROM OBSTRUCTIONS

CITY OF PALO ALTO CALIFORNIA

ENGR	PEV	
DRAWN	UES	MJ
CHECKED	PEV	

NTS	SR-MT-E-1012	1 OF 1
SCALE	STANDARD NO.	SHEET NO.