



MICROTRENCHING AC

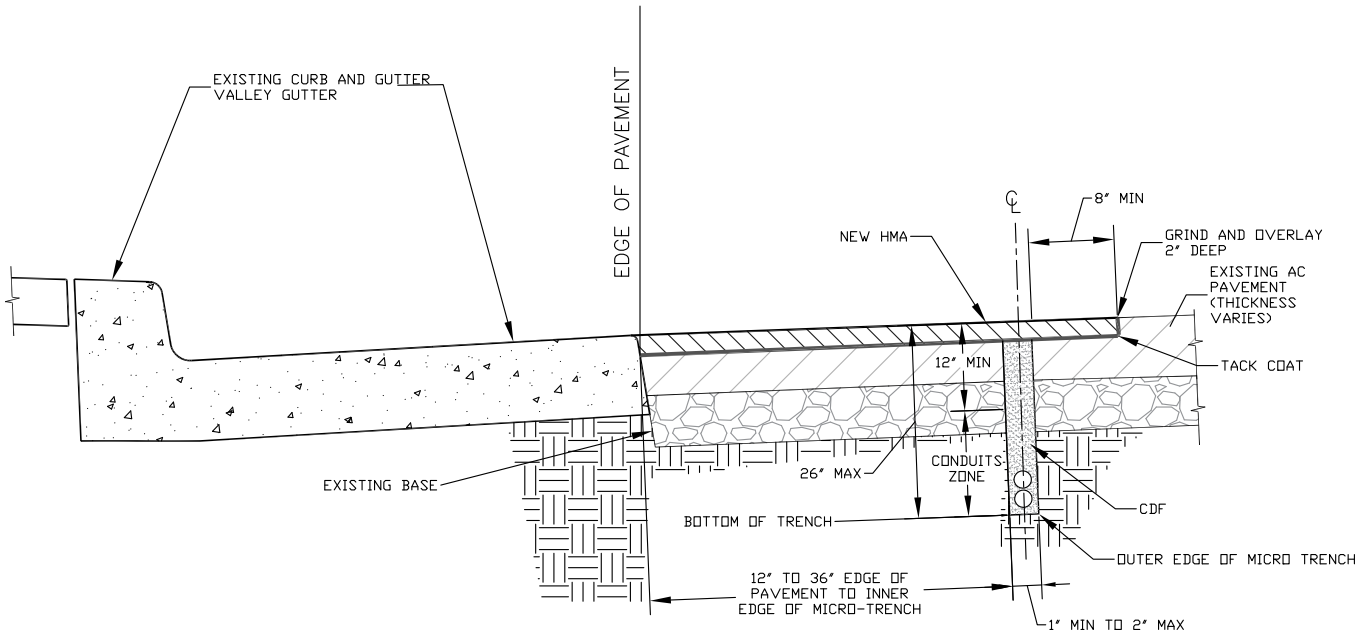

MICROTRENCHING AC OVER PCC / PCC

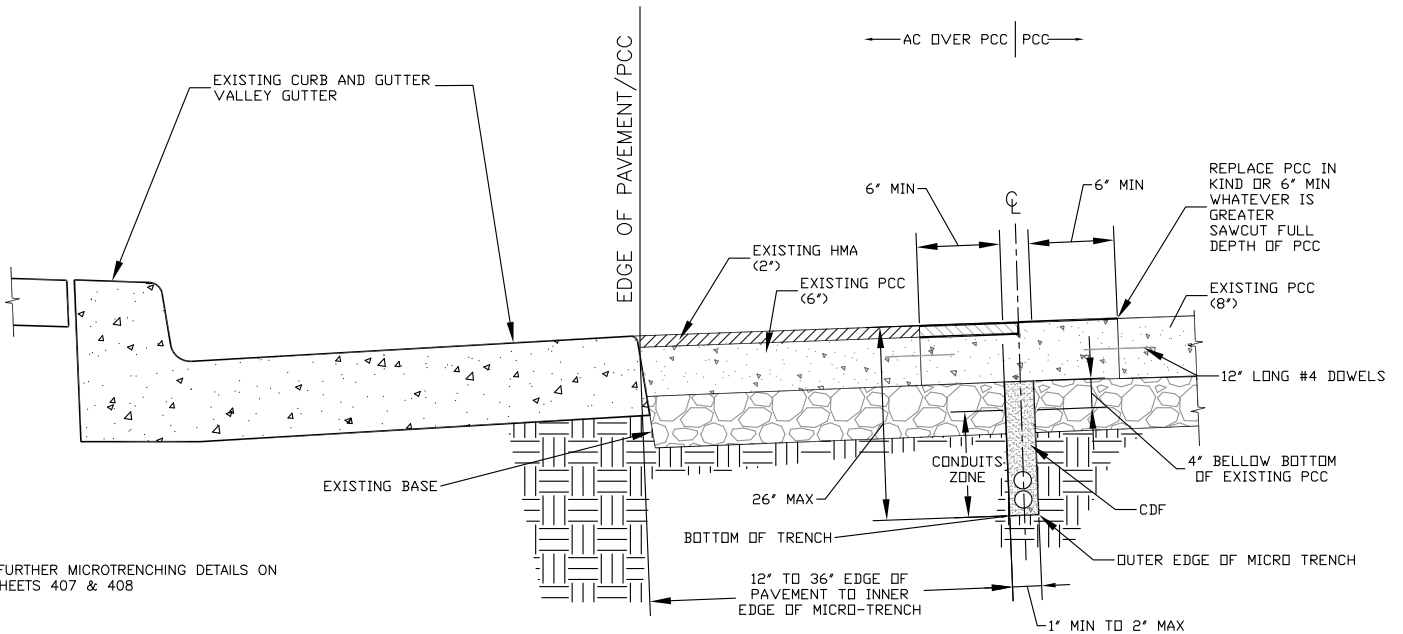


*FURTHER MICROTRENCHING DETAILS ON SHEETS 407 & 408

Rev	By	Date
0	TB	3/3/23
1	TB	6/20/23
2	TB	8/31/23
3	TB	2/06/24
Scale: NTS		

**Micro-Trenching
Construction Detail**

City of Palo Alto Standard

Approved by: 

PE No. C65449
Date 2/12/2024

Dwg No. 406