


ARTERIAL

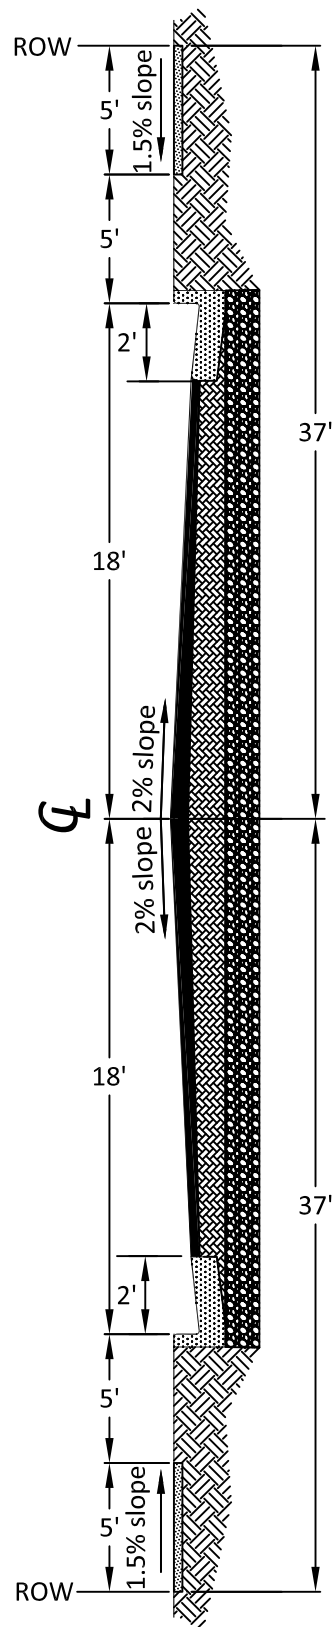

COLLECTOR AND LOCAL


- NOTES:
- The minimum structural section for these streets shall be 2" to 3" of 1/2" MAX medium Asphaltic Concrete over 6" to 8" of Portland Cement Concrete over 6" of Class 2 aggregate base.
  - Roadway cross slopes shall not be less than 2% minimum. Existing cross slope is less than 2%.
  - All roadwork shall take place within City of Palo Alto right-of-way (ROW) as indicated on this drawing.

Rev	By	Date
0	DWH	12/14/92
1	MMN	02/23/09
2	RTN	06/08/17
3	BGL	06/18/18

Scale: NTS

Roadway Cross Sections

City of Palo Alto Standard

Approved by: 

PE No. 72158  
Date 01/10/18

Dwg No. 201A