


SECTION C - C Curb and sidewalk

## NOTES:

- 1. 1/2" min. between pipe flowline and gutter flowline.
- 2. Maximum of three pipes.
- 3. 3" dia. max. pipe size. A rectangular ducts with 3" max. height may be used in lieu of pipe or a rectangular duct of less than 3" may be used to meet capacity requirements when curb height is under 6".
- 4. Thin wall cast iron or ductile iron pipe only.
- 5. 6"x6"x10 ga. wire mesh in sidewalk area only. Extend 9" on each side of pipe.
- 6. Similar detail for Type B (Rolled) curb. Cut the drain pipe flush with the contour of the rolled curb.

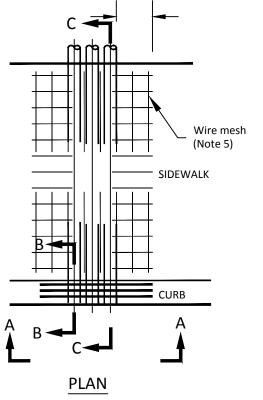

Rev	Ву	Date	Curb Outlet	Approve	ed by:
0	DWH	06/09/08		my c	
1	RTN	06/10/17	tor	PE No.	72158
			Gravity Flow	Date	01/10/18
			City of Dala Alta Ctandard	Dwg	221
Scale: NTS			City of Palo Alto Standard	No.	321