


GENERAL NOTES:

1. A drawdown well dewatering system must be used for groundwater within 2 feet of the deepest excavation.
2. Open pit dewatering is only allowed for rainwater that accumulates at the bottom of the excavation.
3. Dewatering is only allowed April through October.
4. Public Works may require the water discharged to the storm drain system to be tested for contaminants. If testing is required, the contractor must retain an independent testing firm to test the water for the contaminants Public Works specifies and submit the results to Public Works.

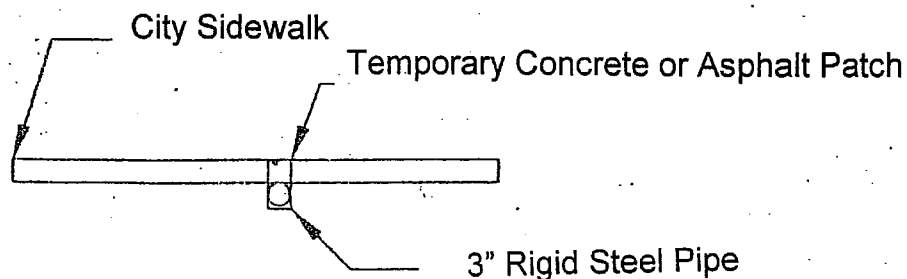

Detail "A-A"
Drain Pipe @
Sidewalk

(A) SECTION THROUGH SIDEWALK
N.T.S.